

13-1 Challenge of Industrial Application of Repair Technologies for FBR Heat Exchanger Tubes — Success in High-Accuracy Wire Feeding to Laser-Irradiated Spot —

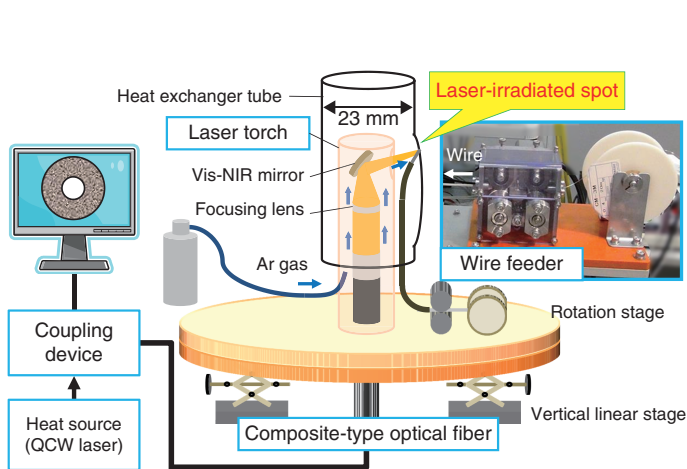


Fig.13-1 Schematic view of laser cladding system in heat exchanger tube

This system was designed to work around the edge of a 23 mm tube. A laser beam was focused on the tube wall by optical lenses and a vis-near-infrared (NIR) heatproof mirror. A wire and Ar gas were supplied to the laser spot. QCW: quasi continuous wave.

We developed an inspection and repair system for use in a heat exchanger tube in a fast breeder reactor (FBR). The key technology in this system was a composite-type optical fiber consisting of a central fiber to deliver the laser beam and surrounding fibers to transmit the visible image. We could observe a crack in the tube wall in the visible image and repair it by laser welding.

Inspection and repair technology for use in a limited tubular space is expected to have wide industrial applications outside of the field of nuclear energy. We are promoting the technical development of a method of repairing wall thinning in heat exchanger tubes in a petrochemical plant. Wall thinning appears as a dimple on the tube wall and is repaired by melting and bonding wires to the base metal. Arc welding is typically used for repairing metal parts. However, in the limited tubular space, the excess heat of the arc often breaks the welding devices and causes inferior welding. A laser beam can be delivered by an optical fiber and concentrate the energy in a local spot, so it is suitable for use in a narrow space.

Precise wire feeding to a small laser-irradiated spot is very

Reference

Nishimura, A., Terada, T. et al., Instrumentation Device and Surface Control Technology for Coolant Piping System of Nuclear Power Plants, Proceedings of the 2012 20th International Conference on Nuclear Engineering Collocated with the ASME 2012 Power Conference (ICONE20), California, USA, 2012, ICONE20-POWER2012-54406, 5p., in DVD-ROM.

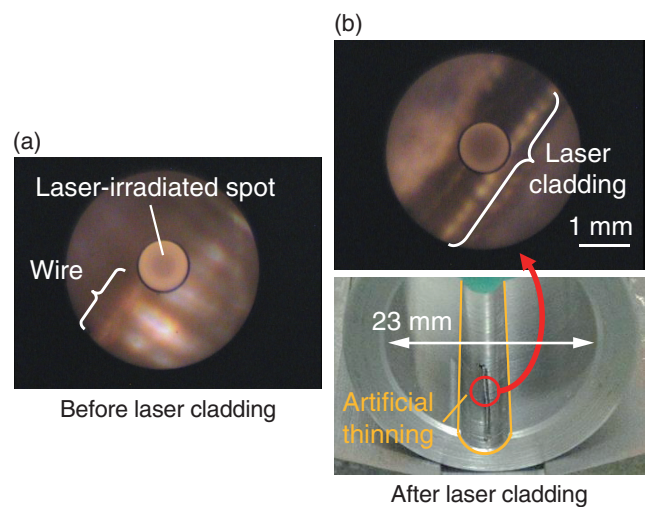


Fig.13-2 Laser cladding on wall of 1 in. tube

(a) Wire moves toward the center of the laser spot. (b) Line cladding deposited on wall was about 1 mm in width and 0.2 mm in height. It is possible to suppress wall thinning by using erosion–corrosion-resistant wire.

important for successful laser cladding. A composite-type optical fiberscope is useful for this purpose. It is necessary to use a welding wire thinner than the typical one because an allowable bending radius is about 10 mm in a 23 mm tube. We developed a new wire feeder in cooperation with an excellent machining company in Fukui (Fig.13-1). This device can continuously feed 0.4 mm wire by adjusting the roller gripping force and varying the feeding speed. Its size is about 10 cm³.

The developed wire feeder, laser torch, and composite-type optical fiber were assembled (Fig.13-1), and the laser cladding in a 23 mm carbon steel tube was examined using this system. As a result, we succeeded in continuously feeding the wire to the laser-irradiated spot and producing a line cladding layer that was about 1 mm in width and 0.2 mm in height (Fig.13-2).

In the future, we will control this laser cladding system automatically so that it will fit inside a tube for practical use in petrochemical plants. In this experiment, the wire was comparable in hardness to the base metal. We will try to use a wire that has high erosion–corrosion resistance to suppress wall thinning.