

7-2 Aiming for Robustness for the Reactor Building to Withstand Severe Natural Disasters – Evaluation of External Hazards to the Reactor Building –

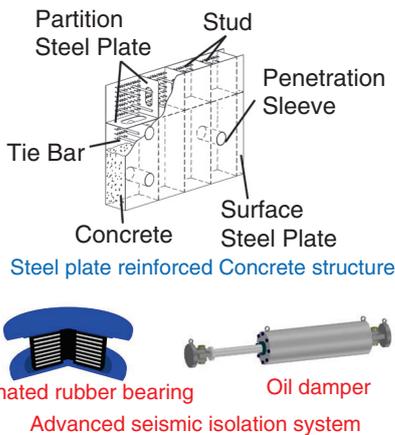


Fig.7-4 Steel plate reinforced concrete (SC) structures and the advanced seismic isolation system

SC structure comprising a pair of steel plates with a concrete filling in between, and an advanced seismic isolation system with laminated rubber bearings and dampers have been investigated.

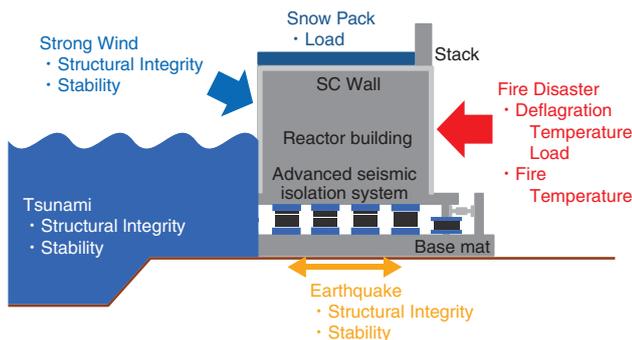


Fig.7-5 Evaluated external hazards

The evaluated external hazards were earthquake, tsunami, snowpack, strong wind, and fire disaster.

A steel plate reinforced concrete (SC) structure has been considered for the building wherein the sodium-cooled fast reactor (SFR) is housed. The SC structure comprises a pair of steel plates with a concrete filling in between, held together by studs, etc. In addition, an advanced seismic isolation system with laminated rubber bearings and oil dampers has been investigated for adoption against earthquakes (Fig.7-4).

In response to the Great East Japan Earthquake and the accident at the TEPCO’s Fukushima Daiichi NPS in March 2011, the structural integrity and stability of reactor buildings against external hazards have been re-evaluated. Fig.7-5 shows the evaluations for earthquake, tsunami, snowpack, strong wind, and fire. These external hazards are threats to the structural integrity and stability of the reactor building; hence, to protect the safety of a reactor building, it must be constructed in such a

Table 7-1 Results of structural integrity evaluation of a reactor building and seismic isolation system against an earthquake

The results of the earthquake evaluation show that the structural integrity and stability of the reactor building and the advanced seismic isolation system were maintained, and the margin (evaluated value/requirement) was greater than two.

		Evaluated items		Margin
Reactor building	Structural integrity	Bending Moment (NS / EW)	2.8 / 2.9	
		Shear force (NS / EW)	2.2 / 3.6	
	Stability	Overturning	7.7	
		Sliding	6.5	
Vertical bearing capacity		7.8		
Seismic isolation system	Laminated rubber bearing	Shear strain	2.1	
		Tensile strain	9.7	
		Compressed strain	2.4	
	Oil damper	Displacement	2.3	

Table 7-2 Results of structural integrity evaluation of a reactor building and seismic isolation system against a tsunami

The results of the tsunami evaluation show that the structural integrity and stability of the reactor building and advanced seismic isolation system were maintained if an appropriate wall thickness was set.

		Evaluated items		Margin
SC structure	Member	Wall Member (wall thickness 1250 mm)	Bending Moment	1.2
			Shear force	1.3
		Building	Bending Moment (NS / EW)	471 / 286
	Shear force (NS / EW)		32 / 16	
	Stability		Overturning	20
	Seismic isolation system	Laminated rubber bearing	Shear strain	3.2
Tensile strain			402	
Compressed strain			– (Not occur)	
Oil damper		Displacement	1.8	

way as to withstand them. In fact, it is necessary to ensure that loads due to earthquakes and tsunamis do not damage an outer wall nor affect the reactor building inside.

The results of the evaluation against earthquake and tsunami are shown in Tables 7-1 and 7-2, respectively. They show that the structural integrity of a reactor building can presumably be maintained with appropriate wall thickness, and that seismic or tsunami loads do not lead to the reactor building being damaged. Evaluation results were also obtained showing that structural integrity could be maintained against other evaluated events, such as snowpack, strong wind, and fire.

This study includes some of the results of the “technical development program on a commercialized FBR plant” entrusted to Japan Atomic Energy Agency (JAEA) by the Ministry of Economy, Trade and Industry of Japan (METI).

Reference

Yamamoto, T. et al., Evaluation of External Hazard on JSFR Reactor Building, Proceedings of 2013 International Congress on Advances in Nuclear Power Plants (ICAPP 2013), Jeju Island, Korea, 2013, paper FD211, 9p., in USB Flash Drive.